



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:
ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

CERTIFICATION REPORT NR.: 111855

Pineville, 02/23/2022

1. DESCRIPTION OF THE WALL COVERING:

TYPE 4A : Three dimensional wallcovering

5mm polyurethane foam, non-woven and textile (Polyester)

2. TEST EXECUTED:

Flammability in accordance with the procedures outlined in ASTM E-84-21
and the N.F.P.A. Life safety code 101

3. CONCLUSION:

Referring to the means of control and the test results, the before mentioned product group
can be classified as follows:

CLASS A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, 'Method of Test of Surface Burning Characteristics of Building Materials', (ASTM E-84-21)

Brad Souffrant
President – American Flamecoat, Inc.

Related commercial names to this product group:

Collection
Eclipse Black & White: Charm
Emblème: Cloud
Enigma: Charm
Intrigue: Caisson
Icons: Curve
Intrigue: Caisson
Kanso
Memento MOOOI: Memic Moth, Pogo Goat
Memphis: Amarna, Sakkara, Ibis, Siwa, Abydos
MOOOI Green House: Lacy Longlegs
MOOOI: Dwarf Rhino, Dodo Pqavone, Flying Coral Fish
MOOOI Spring 2021: Mimic Moth
MOOOI TOKYO BLUE: Shoji Blossom
Senah: Lumera
Spectra: Parquet, Cannage, Caisson
Terra: Arcane, Carvato, Chimu
Velveteen
Yala



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:
ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

PO#: ARTE NV – February 2022
Test Report No: 111855
Date: 02.23.2022

The sample submitted by the client as: ARTE NV – MEMENTO MOOOI –
TESTED ITEM: MO4000 – ADHERED

Designs:

DATE OF RECEIPT: 02.15.2022

TESTING PERIOD: 8 DAYS

TEST REQUESTED: The submitted sample was tested for flammability in
Accordance with the procedures outlined in ASTM E-84-21.

SIGNED





AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:
ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

Date: 02.23.2022

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-21. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The tests were performed in accordance with the specifications set forth in ASTM E-84-21, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:

The test sample identified as ARTE NV – MEMENTO MOOOI – TESTED ITEM: MO4000 – ADHERED was prepared by adhering the material to 5/8" gypsum board glued using Arte clear Pro-5 wallcovering adhesive. This method of sample preparation is described in ASTM E2404-17, standard practice.

TEST PROCEDURE: Adhered

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel and a test conducted in accordance with the standard ASTM E-84-21 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board of the day of the test.

This test sample *meets the A.S.T.M. E-84-21 Standard.

This test sample *meets the N.F.P.A. LIFE SAFETY CODE 101.



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:

ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

Date: 02.23.2022

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-21 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: ARTE NV – MEMENTO MOOOI –
TESTED ITEM: MO4000 – ADHERED

Designs:

Flame Index = 15
Smoke Developed Value = 70

Observation: Tested Fabric Meets the Requirements for ASTM E-84


Conclusion Rating: Class A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84-21)


The classifications are as follows:

Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450

Client: ARTE NV
Report#: 111855
Sample: MEMENTO MOOOI – MO4000 – ADHERED
Designs:

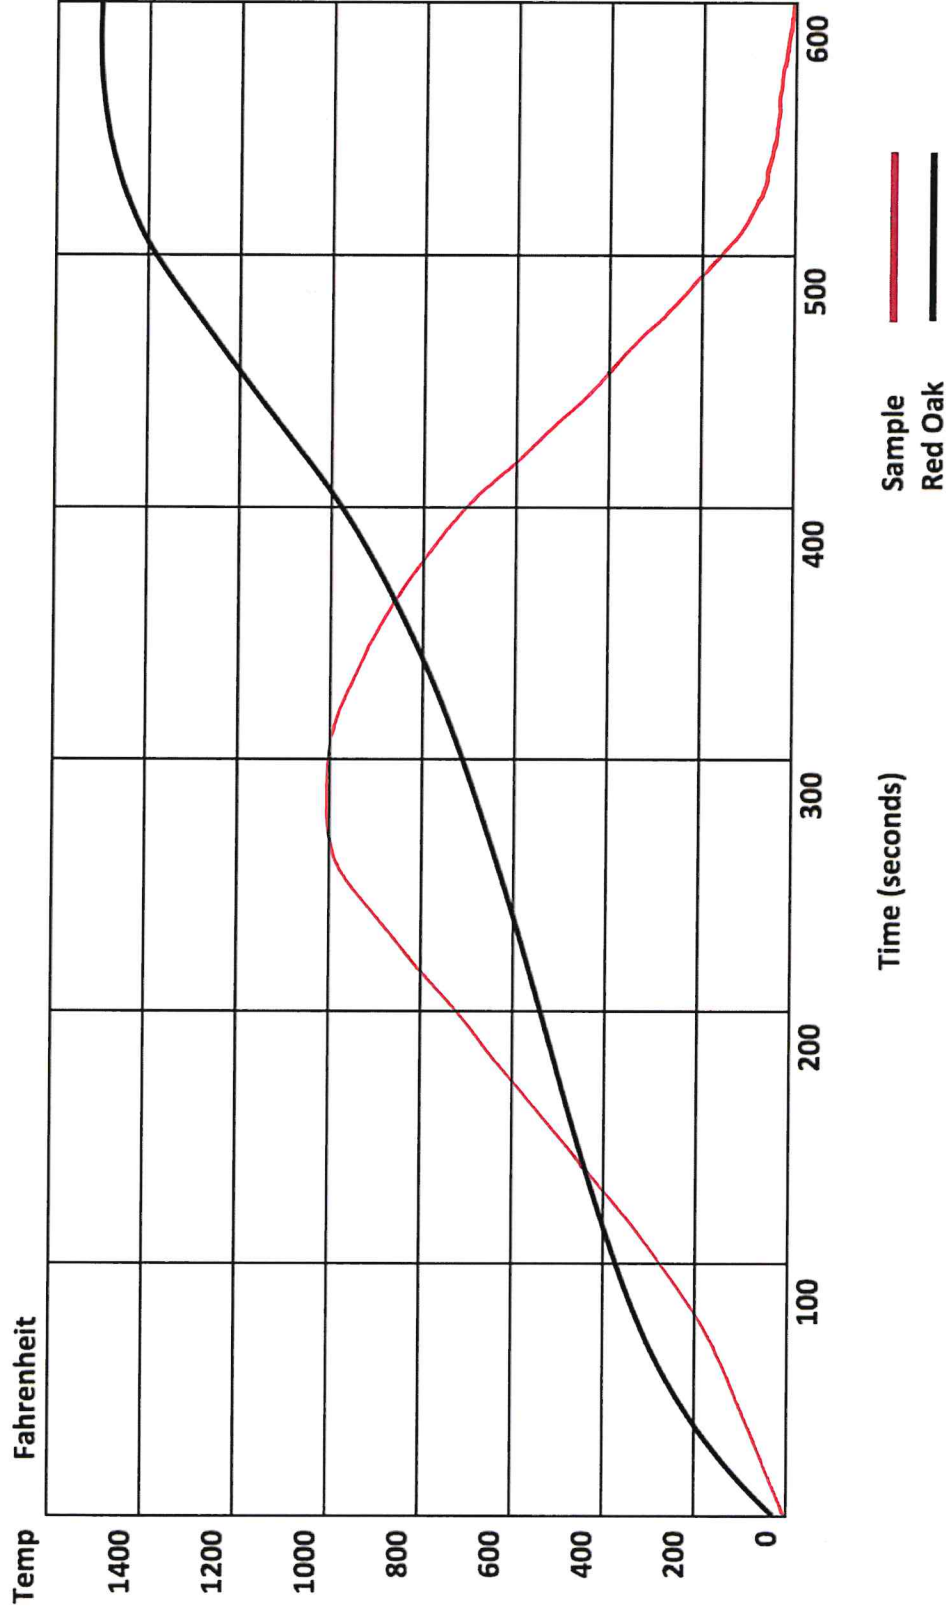

Client: ARTE NV
Report#: 111855
Sample: MEMENTO MOOOI – MO4000 – ADHERED
Designs:

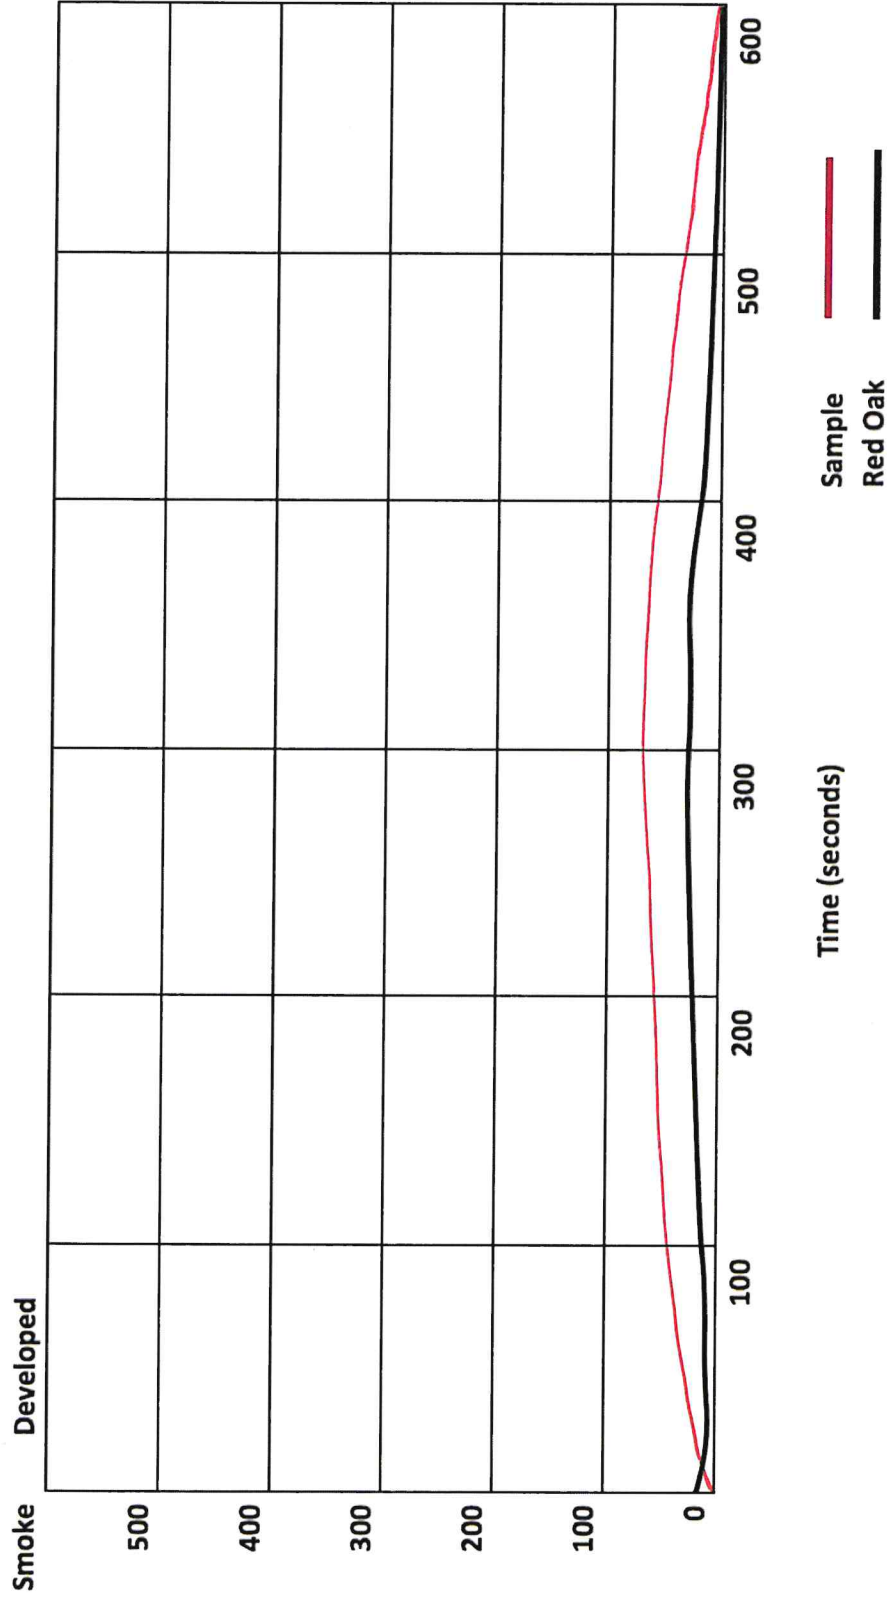

Client: ARTE NV
Report#: 111855
Sample: MEMENTO MOOOI – MO4000 – ADHERED
Designs:

