



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:
ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

CERTIFICATION REPORT NR.: 108809

Pineville, 02.14.2023

1. DESCRIPTION OF THE WALL COVERING:

TYPE 2: Wallcovering with natural materials and decorative elements

2. TEST EXECUTED:

Flammability in accordance with the procedures outlined in ASTM E-84-21 and the N.F.P.A. Life safety code 101

3. CONCLUSION:

Referring to the means of control and the test results, the before mentioned product group can be classified as follows:

CLASS A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, 'Method of Test of Surface Burning Characteristics of Building Materials', (ASTM E-84-21)

Thank you,

Brad Souffrant
President – American Flamecoat, Inc.

Related commercial names to this product group:

| |
|---|
| Collection |
| All Naturals |
| Artisan |
| Bark Cloth |
| Boracay |
| Boutique: Agave, Alentejo Cork, Sunburst |
| Cantala: Papyrus, Raphia |
| Carabao |
| Emblème: Coti, Under the Sycamore Tree |
| Expedition: Java |
| Heliodor |
| Icarus: Alata, Indomito, Penumbrea, Telaio |
| Icons: Waffle Weave, Rattan |
| Insero |
| Kaolin: Hortus, Grezzo |
| Kharga: Ténééré |
| Les Forêts: Ajoura, Éclat, Infini, Ruban |
| Ligna: Scope |
| Manovo |
| Marquesa: Atuona, Cyperus, Fenua, Taio |
| Marqueterie |
| Melaky: Alba, Farini, Rubra, Tana |
| Memento MOOOI: Queen Cobra, Golden Tiger |
| MOOOI Green House: Woodblock Beetle Flora, Woodblock Beetle Fern |
| MOOOI Tokyo Blue: Lucky O's |
| MOOOI: Armoured Bear, Bearded Leopard |
| Oculaire |
| Osmanthus: Chasu, Gardens of Okayama, Kudzu, Line, Sambe, Tatami |
| Prismatic |
| Revera: Align |
| Takara: Air, Feather, Harmony, Spirit |
| Timber |
| Wildwalk: Ferox |
| Zephyr: Allagi, Kinisi |



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:
ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

PO#: ARTE NV
Test Report No: 108809
Date: 02.14.2023

The sample submitted by the client as: ARTE NV -
Type 2 = Wallcovering with Natural Materials and Decorative Elements

(ADHERED)

DATE OF RECEIPT: 02.03.2023

TESTING PERIOD: 9 DAYS

TEST REQUESTED: The submitted sample was tested for flammability in
Accordance with the procedures outlined in ASTM E-84 21.

SIGNED





AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:
ARTE NV
INDUSTRIEZONE "DE WAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

Date: 02.14.2023

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-21. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The tests were performed in accordance with the specifications set forth in ASTM E-84-21, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the IO-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:

The test sample identified as ARTE NV - Type 2 = Wallcovering with Natural Materials and Decorative Elements - ADHERED was prepared by adhering the material to 5/8" gypsum board glued using Arte CLEAR-PRO wallcovering adhesive. This method of sample preparation is described in ASTM E2404-17, standard practice.

TEST PROCEDURE: Adhered

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel and a test conducted in accordance with the standard ASTM E-84-21 procedures.

The operation of the tunnel was checked by performing a IO-minute test with inorganic board of the day of the test.

This test sample ***meets** the A.S.T.M. E-84-21 Standard.

This test sample **-1'_mee** the N.F.P.A. LIFE SAFETY CODE 101.



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D
Pineville, NC 28134
O: 704.405.2550
F: 704.543.9772
www.americanflamecoat.com

Client:

ARTE NV
INDUSTRIEZONE "DEWAERDE"
SENATOR A. JEURISSENLAAN 1210
BE-3520 ZONHOVEN, BELGIUM

Date: 02.14.2023

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-21 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: ARTE NV - ARTE NV -Type 2 = Wallcovering with Natural Materials and Decorative Elements
ADHERED

Flame Index = 10
Smoke Developed Value = 40

Observation: Tested Fabric Meets the Requirements for ASTM E-84


Conclusion Rating: Class A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84-21)


The classifications are as follows:

| | | |
|---|------------------|-------|
| Class A Interior Wall & Ceiling Finish: | Flame Spread- | 0-25 |
| | Smoke Developed- | 0-450 |
| Class A Interior Wall & Ceiling Finish: | Flame Spread- | 0-25 |
| | Smoke Developed- | 0-450 |

Client: ARTE NV
Report#: 108809
Sample: Type 2 = Wallcovering with Natural Materials and Decorative Elements (Adhered)

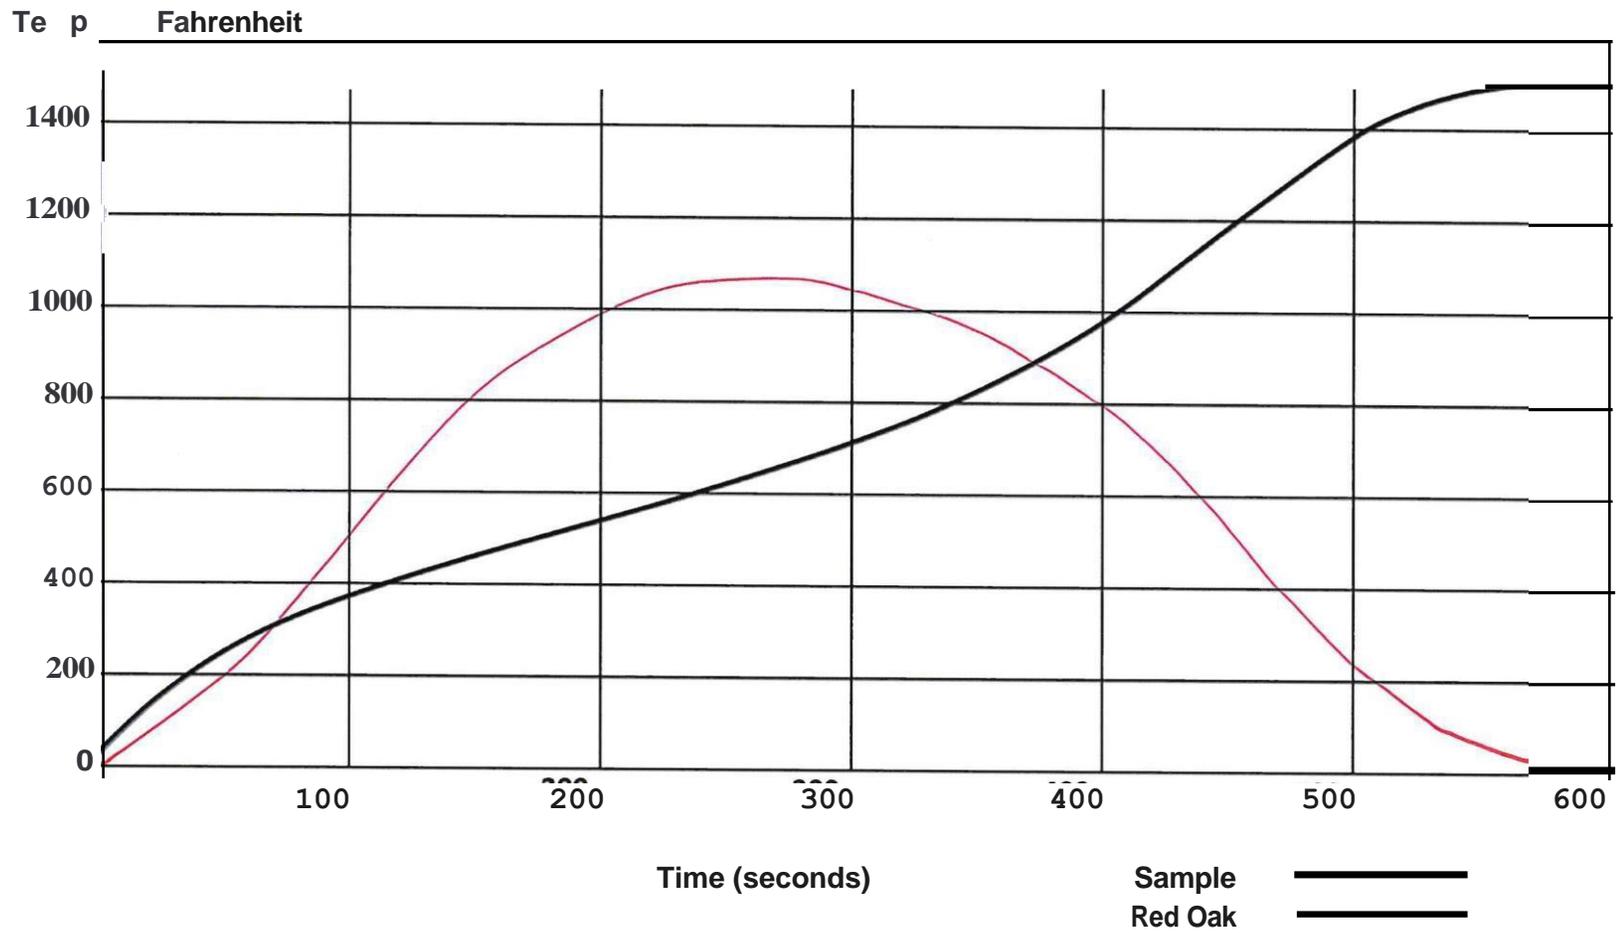

Client: ARTE NV
Report#: 108809
Sample: Type 2 = Wallcovering with Natural Materials and Decorative Elements
(Adhered)

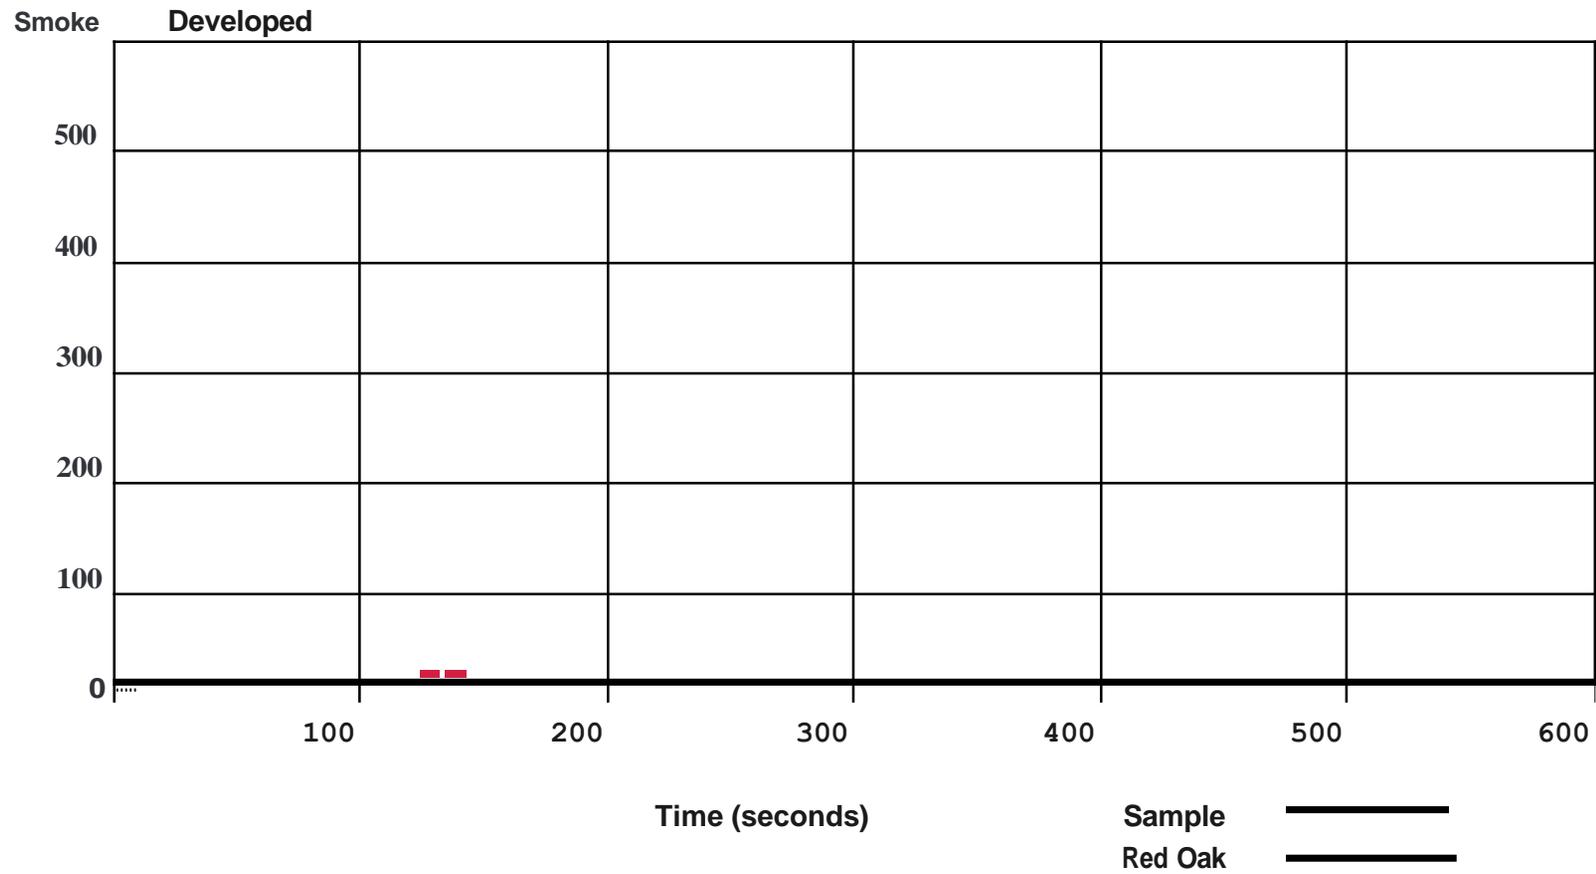

Client: ARTE NV
Report#: 108809
Sample: Type 2 = Wallcovering with Natural Materials and Decorative Elements (Adhered)

